	TECHNICAL SPECIFICATION		Nº	I-ET-3010.00-1210-888-P4X-003		
	CLIENT:				SHEET: 1 of 15	
	PROJECT:					
	UNIT:					
SRGE	TITLE: SESDVS CONTROL RACK				INTERNAL	
					ESUP	

MICROSOFT WORD / V. 365 / I-ET-3010.00-1210-888-P4X-003_A.DOC

INDEX OF REVISIONS

REV.	DESCRIPTION AND/OR REVISED SHEETS
0	ORIGINAL ISSUE
A	REVISED WHERE INDICATED

	REV. 0	REV. A	REV. B	REV. C	REV. D	REV. E	REV. F	REV. G
DATE	AUG/21/20	OCT/07/22						
DESIGN	ESUP	ESUP						
EXECUTION	U44D	U44D						
CHECK	U5D6	U5D6						
APPROVAL	U49R	CDC1						

INFORMATION IN THIS DOCUMENT IS PROPERTY OF PETROBRAS, BEING PROHIBITED OUTSIDE OF THEIR PURPOSE
FORM OWNED TO PETROBRAS N-381 REV. L



UNIT:

SHEET 2 of 15

TITLE:


SESDVS CONTROL RACK

INTERNAL

ESUP

SUMMARY

1	INTRODUCTION.....	3
2	REFERENCE DOCUMENTS, CODES AND STANDARDS	3
3	OPERATIONAL CONDITIONS	5
4	CONSTRUCTION REQUIREMENTS	7
5	CONNECTIONS AND TUBINGS	7
6	RACK INLETS AND OUTLETS	8
7	INSTRUMENTATION	9
8	IDENTIFICATION	13
9	DOCUMENTATION	13
10	ACCEPTANCE TESTS.....	14
11	PACKING REQUIREMENTS	15

	TECHNICAL SPECIFICATION	Nº: I-ET-3010.00-1210-888-P4X-003	REV. A
	UNIT:	SHEET 3 of 15	
	TITLE:	SESDVS CONTROL RACK	
		INTERNAL	
		ESUP	

1 INTRODUCTION

1.1 Object

1.1.1 This technical specification describes the minimum requirements and basic characteristics of the SESDVs Control Rack for UNIT.

1.1.2 1 (one) SESDVs Control Rack shall be supplied.

1.1.3 This rack shall be modular and shall hold the commands for 4 (four) Subsea Emergency Shutdown Valves.

1.2 Definitions

1.2.1 Refer to I-ET-3010.00-1200-940-P4X-002 – GENERAL TECHNICAL TERMS

1.3 Abbreviations, Acronyms and Initialisms


A&C	Automation & Control
BSDL	<i>Boca de Sino DiverLess</i>
CSS	Control and Safety System
FAT	Factory Acceptance Test
HPU	Hydraulic Power Unit
PCS	Process Control System
PSD	Process Shutdown System
SAT	Site Acceptance Test
SESDV	Subsea Emergency Shutdown Valve
SIT	Site Integration Test

2 REFERENCE DOCUMENTS, CODES AND STANDARDS

2.1 Internal References

2.1.1 Project Documents

I-ET-3010.00-1200-800-P4X-013	GENERAL CRITERIA FOR INSTRUMENTATION PROJECTS
I-ET-3000.00-5139-800-PEK-004	HYDRAULIC POWER UNIT FOR SUBSEA EQUIPMENT WITH MULTIPLEXED ELECTROHYDRAULIC AND DIRECT HYDRAULIC CONTROL SYSTEM (OWN FLOATING PRODUCTION UNIT)
I-ET-3010.00-5140-700-P4X-003	ELECTRICAL REQUIREMENTS FOR PACKAGES FOR OFFSHORE UNITS
I-DE-3010.00-1210-888-P4X-006	SESDVS CONTROL RACK - FUNCTIONAL DIAGRAM
I-DE-3010.00-1210-888-P4X-005	SESDVS CONTROL RACK - LAYOUT

	TECHNICAL SPECIFICATION	Nº: I-ET-3010.00-1210-888-P4X-003	REV. A
	UNIT:	SHEET 4 of 15	
	TITLE:	INTERNAL	
SESDVS CONTROL RACK		ESUP	

2.1.2 Names below and respective document codes may vary according to each project but, in general, the following documents shall be considered along with this technical specification.

- AUTOMATION AND CONTROL ARCHITECTURE
- AUTOMATION AND CONTROL SYSTEM FUNCTIONS
- FIELD INSTRUMENTATION
- GENERAL ARRANGEMENT
- INSTRUMENTATION ADDITIONAL TECHNICAL REQUIREMENTS

2.2 External References

2.2.1 International Codes, Recommended Practices and Standards

API - AMERICAN PETROLEUM INSTITUTE

API	RP-14B	DESIGN, INSTALLATION, OPERATION, TEST AND REDRESS OF SUBSURFACE SAFETY VALVE SYSTEMS
API	RP-14C	ANALYSIS, DESIGN, INSTALLATION AND TESTING OF SAFETY SYSTEMS FOR OFFSHORE PRODUCTION FACILITIES

IEC - INTERNATIONAL ELECTROTECHNICAL COMMISSION


IEC	60079	EXPLOSIVE ATMOSPHERES
IEC	60529	DEGREES OF PROTECTION PROVIDED BY ENCLOSURES (IP CODE)
IEC	60533	ELECTRICAL AND ELECTRONIC INSTALLATIONS IN SHIPS - ELECTROMAGNETIC COMPATIBILITY (EMC) – SHIPS WITH A METALLIC HULL
IEC	61000	ELECTROMAGNETIC COMPATIBILITY (EMC) SERIES - ALL PARTS
IEC	61892	MOBILE AND FIXED OFFSHORE UNITS – ELECTRICAL INSTALLATIONS – ALL PARTS

INMETRO - INSTITUTO NACIONAL DE METROLOGIA, NORMALIZAÇÃO E QUALIDADE INDUSTRIAL

PORTARIA Nº 115 (21 / MARÇO / 2022)	REQUISITOS DE AVALIAÇÃO DA CONFORMIDADE PARA EQUIPAMENTOS ELÉTRICOS PARA ATMOSFERAS EXPLOSIVAS - CONSOLIDADO.
-------------------------------------	---

ISO – INTERNATIONAL STANDARD ORGANIZATION

ISO	4406	HYDRAULIC FLUID POWER - FLUIDS - METHOD FOR CODING THE LEVEL OF CONTAMINATION BY SOLID PARTICLES
ISO	13628-6	PETROLEUM AND NATURAL GAS INDUSTRIES – DESIGN AND OPERATION OF SUBSEA PRODUCTION SYSTEMS – PART 6: SUBSEA PRODUCTION CONTROL SYSTEMS
ISO	16889	HYDRAULIC FLUID POWER - FILTERS - MULTI-PASS METHOD FOR EVALUATING FILTRATION PERFORMANCE OF A FILTER ELEMENT

	TECHNICAL SPECIFICATION	Nº: I-ET-3010.00-1210-888-P4X-003	REV. A
	UNIT:	SHEET 5 of 15	
	TITLE:	INTERNAL	
SESDVS CONTROL RACK		ESUP	

2.2.2 Classification Society

2.2.2.1 The FPSO basic design follows the requirements of Classification Society and its rules and comments were taken into account at the documents.

2.2.2.2 The detailed design shall also be submitted to approval by the same Classification Society. The design and installation shall take into account their requirements and comments.

2.2.2.3 The design, installation and operation shall strictly follow the Classification Society requirements, together with the specific requirements identified in this document, including also all referenced documents requirements.

2.2.3 Certification

2.2.3.1 To prove compliance with area classification, Certificates of Conformity in accordance with PORTARIA INMETRO Nº 115, de 21/março/2022, and its annexes, shall be supplied.

2.3 Brazilian Codes and Standards

2.3.1 All MTE – Ministério do Trabalho e Emprego regulations (NRs) shall be followed.

2.3.2 Order of Precedence

2.3.2.1 Regarding to minimize conflicts among project documents, except where specific codes and regulations are more stringent, the order of precedence of technical documents shall otherwise be:

- This Specification;
- Project Documents listed on item 2.1.1 and 2.1.2 above;
- Codes and Standards.

3 OPERATIONAL CONDITIONS


3.1 The SESDVs Control Rack shall be installed in open area, for SESDVs Control Rack operating and environmental conditions refer to INSTRUMENTATION ADDITIONAL TECHNICAL REQUIREMENTS.

3.2 The SESDVs Control Rack and all its components shall be appropriated for Zone 2, Group IIA, T3 Classified areas according to IEC-60079 standard.

3.3 The SESDVs Control Rack's exact location on the UNIT shall be according to GENERAL ARRANGEMENT.

3.4 The rack shall use a water bases hydraulic fluid with 3 (three) µm absolute filtering.

3.5 Power supply available to SESDVs Control Rack: 24 Vdc +10% - 15% (voltage drop on cable not included).

	TECHNICAL SPECIFICATION	Nº: I-ET-3010.00-1210-888-P4X-003	REV. A
	UNIT:	SHEET 6 of 15	
	TITLE:	INTERNAL	
SESDVS CONTROL RACK		ESUP	

3.6 The hydraulic power for the SESDVs with direct control will be provided by the Hydraulic Power Unit for Subsea System, see Technical Specification I-ET-3000.00-5139-800-PEK-004 – HYDRAULIC POWER UNIT FOR SUBSEA EQUIPMENT WITH MULTIPLEXED ELECTROHYDRAULIC AND DIRECT HYDRAULIC CONTROL SYSTEM (OWN FLOATING PRODUCTION UNIT), through pressure regulator valves at the following level of pressure:

- **LOW PRESSURE LEVEL:** for operation of the SESDVs, with pressure adjustable from 9,308 kPa (1,350 psi) to 22,752 kPa (3,300 psi).

3.7 Operation Hydraulic Fluid

3.7.1 The SESDVs Control Rack hydraulic fluid shall be MacDermid Oceanic HW 525P, HW443 or Castrol Transaqua DW (choice to be later taken by PETROBRAS).

3.7.2 For further information, see I-ET-3000.00-5139-800-PEK-004 – HYDRAULIC POWER UNIT FOR SUBSEA EQUIPMENT WITH MULTIPLEXED ELECTROHYDRAULIC AND DIRECT HYDRAULIC CONTROL SYSTEM (OWN FLOATING PRODUCTION UNIT).


NOTE: Such fluids shall not be indiscriminately mixed, it being accepted only the migration of use from one to the other, with a minimum 12 (twelve) month waiting period for a new migration mixture.

3.8 Preservation Hydraulic Fluid until Pre-Operation phase

3.8.1 In case PETROBRAS specifies MacDermid Oceanic HW 525P fluid, the Rack hydraulic circuit shall be filled with MacDermid Oceanic HW 443 hydraulic fluid from manufacturing until just before pre-operation phase in Brazil, aiming at internal protection against corrosion from the vapor phase of the fluid during possible long weather storage period. In such cases, the HW 443 fluid shall be substituted by HW 525P during the final phase of commissioning and pre-operation in Brazil.

3.8.2 In case PETROBRAS specifies Castrol Transaqua DW fluid, the Rack shall be filled with the same hydraulic fluid from manufacturing until just before pre-operation phase in Brazil, aiming at internal protection against corrosion from the vapor phase of the fluid during possible long storage periods exposed to the elements. In such cases, only completing of the fluid is necessary at the end of the commissioning and pre-operation phase in Brazil.

3.8.3 For further information, see I-ET-3000.00-5139-800-PEK-004 – HYDRAULIC POWER UNIT FOR SUBSEA EQUIPMENT WITH MULTIPLEXED ELECTROHYDRAULIC AND DIRECT HYDRAULIC CONTROL SYSTEM (OWN FLOATING PRODUCTION UNIT).

	TECHNICAL SPECIFICATION	Nº: I-ET-3010.00-1210-888-P4X-003	REV. A
	UNIT:	SHEET 7 of 15	
	TITLE:	INTERNAL	
SESDVS CONTROL RACK		ESUP	

3.9 Hydraulic Fluid Cleanliness Class

3.9.1 The SESDVs Control Rack shall be appropriate to operate with Cleanliness Class 19/17/14 according to ISO 4406 (equivalent to Class 8 of NAS1638 Standard). However, the nominal fluid cleanliness class shall be ISO 4406 17/15/12 (equivalent to Class 6 of NAS1638 Standard).

4 CONSTRUCTION REQUIREMENTS

4.1 General Requirements

4.1.1 The SESDVs Control Rack structure shall be modular self-supported closed type panel, with the possibility of actuation of 4 (four) Subsea Emergency Shutdown Valves. Up to one of those outlets for valves shall be used for a BSDL system. For further details, see I-DE-3010.00-1210-888-P4X-006 - SESDVS CONTROL RACK - FUNCTIONAL DIAGRAM.

4.1.2 The rack shall have 1 (one) front door and 1 (one) rear door, all with transparent polycarbonate windows to allow visualization of the state open/closed of the control valves. The access doors shall allow easy access to the whole extension of the rack and shall be fixed by means of continuous hinges made of AISI 316L. The doorknobs shall be reinforced.

4.1.3 The rack shall be built of at least AISI 316L stainless steel specification shapes and sheets.

4.1.4 The rack layout shall be in accordance with typical layout I-DE-3010.00-1210-888-P4X-005 - SESDVS CONTROL RACK - LAYOUT.

4.1.5 All cuts and drilling operations shall be done cold.


4.1.6 All pneumatic and hydraulic lines, connections, valves and other internal accessories to the panels, shall be made of AISI 316 stainless steel.

4.1.7 AISI 316L stainless steel shall be used in the manufacture of the supporting skid. The panel plates shall be free of warping, wrinkling, roughness, signs of rust and corrosion, and they shall have the same minimum thickness of 3.175 mm for sides, ceiling, bottom, and doors, and 4.760 mm for panel front side

5 CONNECTIONS AND TUBINGS

5.1 All tubing and fittings shall be in accordance with I-ET-3010.00-1200-800-P4X-013 - GENERAL CRITERIA FOR INSTRUMENTATION PROJECTS.

5.2 All lines and components operating with hydraulic fluid shall be sized to operate with 3:1 safety factor.

	TECHNICAL SPECIFICATION	Nº: I-ET-3010.00-1210-888-P4X-003	REV. A
	UNIT:	SHEET 8 of 15	
	TITLE:	INTERNAL	
	SESDVS CONTROL RACK		ESUP

- 5.3 The removal of any component shall be preferably executed from the front part of the rack and shall not require the removal of other circuits than the one that is being fixed.
- 5.4 The connection with the SESDVs control rack shall be made at the lower part of the rack through a bulkhead type connection, in line, or at most in 2 (two) lines where 1 (one) is shifted related to the other at half the distance between the connections, to allow connection or disconnection of any line without interfering with the others.
- 5.5 All lines shall be adequately supported and arranged in a way to avoid damage when in operation, facilitate maintenance and minimize their respective lengths.
- 5.6 All hydraulic connections in the SESDVs Control Rack shall have a capacity to preserve their sealing for at least 30 (thirty) years of service.
- 5.7 If sealant is used in threaded connections, seal shall be made by chemical thread sealant. The usage of Teflon Tape is not allowed.

6 RACK INLETS AND OUTLETS

6.1 Hydraulic Outlets

- 6.1.1 1 (one) hydraulic fluid return outlet rated LEVEL 3300 psi (22753 kPa), for the actuation of SESDVs, in 2" (minimum) outside diameter tubing with adaptation for a union type outlet for the panel, 9/16" – 18 JIC 37º, class 6000 psi (41369 kPa). This outlet shall not be connected to the HPU.
- 6.1.2 4 (four) outlets of rated LEVEL 3300 psi (22753 kPa), for the actuation of the SESDVs, in 3/8" outside diameter tubing with adaptation for a union type outlet for the panel, 9/16" - 18 JIC 37º, class 6000 psi (41369 kPa).


6.2 Hydraulic inlets

- 6.2.1 1 (one) inlet at pressure LEVEL 3300 psi (22753 kPa) of hydraulic fluid supply for the SESDV valves, in 2" (minimum) OD tubing.

NOTE: Hydraulic inlet/outlet diameters shall be confirmed during project development.

6.3 Electric Inlets

- 6.3.1 4 (four) Inlets for the actuation of the solenoid valves (in 24 Vdc) by CSS or BSDL system.

	TECHNICAL SPECIFICATION	Nº: I-ET-3010.00-1210-888-P4X-003	REV. A
	UNIT:	SHEET 9 of 15	
	TITLE:	SESDVS CONTROL RACK	
		INTERNAL	
		ESUP	

6.4 Electric outlets

6.4.1 3 (three) outlets for remote valve position (discrete signal, voltage free contact)

NOTE: The hydraulic outlet used for BSDL system does not have pressure or position monitoring. For further details, see I-DE-3010.00-1210-888-P4X-006 - SESDVS CONTROL RACK - FUNCTIONAL DIAGRAM

6.4.2 1 (one) outlet analog signal for remote supply pressure monitoring.

6.4.3 1 (one) outlet analog signal for remote return pressure monitoring.

6.4.4 The panel rack shall be provided with, at least, 1 (one) junction box for FPSO interconnection. Junction Boxes shall be specified in accordance with I-ET-3010.00-1200-800-P4X-013 - GENERAL CRITERIA FOR INSTRUMENTATION PROJECTS.

6.4.5 Junction boxes shall be supplied with terminals with non-sparking terminations, capable of withstanding vibration and environmental conditions.

6.4.6 The cables that conduct the signals from the transmitters to the junction box shall have electrostatic shields that shall not be grounded but rather connected to the terminal at the junction box.

6.4.7 All cased electric devices shall have IP-56 protection level.

7 INSTRUMENTATION


7.1 Instrumentation shall be in accordance with the document I-ET-3010.00-1200-800-P4X-013 - GENERAL CRITERIA FOR INSTRUMENTATION PROJECTS and FIELD INSTRUMENTATION.

7.2 All panels, instruments, materials and equipment proper to be used in hazardous areas, shall have conformity certificates complying with "PORTARIA INMETRO Nº 115, de 21/março/2022", and its annexes, and shall be approved by Classification Society.

7.3 All electrical and electronic devices, beyond mechanical parts of the equipment, shall be designed and constructed in a tropicalized version. Tropicalization process comprises application of reinforced protective resin Class 2 according to IEC 61086 and fungus proof according to ASTM G21 in all printed circuit boards, use of anti-rust materials and accessories and other implementations according to MANUFACTURERS' experiences and related rules, aiming to provide a robust and reliable construction.

7.4 Transmitter

7.4.1 Each hydraulic supply and return header, and each hydraulic actuator supply line of SESDVs shall have a pressure transmitter. The transmitter on the actuator supply lines shall be used for indirect indication of the position of the valve.

	TECHNICAL SPECIFICATION	Nº: I-ET-3010.00-1210-888-P4X-003	REV. A
	UNIT:	SHEET 10 of 15	
	TITLE:	SESDVS CONTROL RACK	
		INTERNAL	
		ESUP	

7.4.2 Pressure transmitters shall be in accordance with I-ET-3010.00-1200-800-P4X-013 - GENERAL CRITERIA FOR INSTRUMENTATION PROJECTS and FIELD INSTRUMENTATION. Also, the following additional requirements shall be met:

- Pressure connection: 1/2" NPT plug;
- Overpressure: 200% the operation range;
- Operating range: 0 to 4000 psi (27579 kPa);
- Seals: appropriate for the specified hydraulic fluid;

7.4.3 The transmitter shall be installed in a manifold with multiple block and bleed valves.

7.4.4 All isolation of electric instruments shall have at least IP-56 protection level and shall be fit to work in environment described in item 3.

7.5 Directional Valves

7.5.1 The diagram of valves shall be in accordance with I-DE-3010.00-1210-888-P4X-006 - SESDVS CONTROL RACK - FUNCTIONAL DIAGRAM.

7.5.2 The solenoid valves used for the actuation SESDVs shall be 3 (three) way, two positions, piloted operated, fail-safe type, open when energized, with a return spring, according to the type, model and supplier previously qualified by PETROBRAS. Individual power of each solenoid from pilot operated DCVs shall be less or equal to 3.5W.


7.5.3 The manifold blocks for solenoid valves shall have integrated block valves, as well as one hydraulic supply header LEVEL 3300 psi (22753 kPa), with 6 mm internal diameter, for the SESDVs, each with 3/8" NPT socket connection. The manifold shall also have one internal return header with 10 mm internal diameter, for the same level of pressure as the above, but with 1/2" NPT female connection.

7.5.4 The valve hydraulic pilots shall be supplied by an independent header fitted with an accumulator and a flow restrictor, so that it doesn't get affected by a pressure drop at the valve main body when the valve opens.

7.5.5 Directional Valves shall have at least the following characteristics:


- Solenoid actuator with operational voltage of 24V \pm 25%;
- Maximum power consumption of 3.5W;
- Working Pressure of 1350 psi (9308 kPa) to 3300 psi (22753 kPa). Working pressure will be defined during Detailing Engineering Design
- Shutdown pressure: 800 psi (5516 kPa) (alignment to valve return in case of pressure loss);
- Connection: adequate for assembly on manifold (6 mm accesses);
- Internal Accesses: 6 mm (minimum);
- If is not possible to determinate the exact internal passage section, the valve shall be in accordance with the minimum flow x maximum pressure drop curve below;
- Pilot hydraulic supply shall be independent from hydraulic power supply;

- Directional Valve sealing shall be adequate to operation fluid;
- Directional Valve body material shall be AISI 316;
- Solenoids: epoxy box, temperature class F, minimum protection degree IP-56 (adequate for saline ambient) and adequate to operate on environmental conditions established on item 3 (including hazardous area classification);
- Assembly type: manifold – minimum number of 6 valves per manifold;
- Adequate to operate with a water-glycol based hydraulic fluid (as described on this document) which may contain up to 20% on volume of sea water filtered in 10 micron abs.

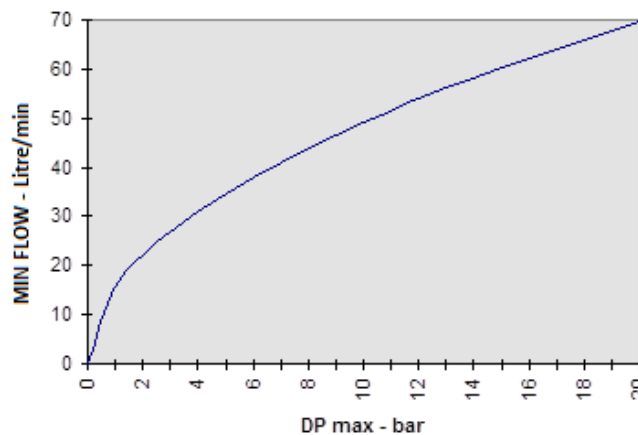MIN FLOW X MAX PRESSURE DROP


7.5.6 Directional Valves minimum required performance during service life:

- Maximum flow in closed position: 0.1 cm³/min;
- Maximum return flow with valve open: 0.0 cm³/min;
- Maximum flow when valve transitioning from closed to open position: 0.1 cm³/min;
- Valve Electro mechanic maximum response time: 1s;
- Maximum operation current (Transient): 1A;
- Holding current at 24Vdc: 150mA;
- Maximum Holding current: 300mA;
- Minimum operation cycles without failure or sealing alteration: 5000;
- Minimum energized hours without solenoid failure: 43800;
- Service life time: 25 years;
- Valve's construction materials shall not present potential reactivity that could lead to galvanic corrosion;
- Valve shall be capable of endure sea water contamination up to 20% on volume between 4°C and 45°C;
- Valve's construction materials shall not allow the development of bacteria on fluid.

	TECHNICAL SPECIFICATION	Nº: I-ET-3010.00-1210-888-P4X-003	REV. A
	UNIT:	SHEET 12 of 15	
	TITLE:	SESDVS CONTROL RACK	
		INTERNAL	
		ESUP	

7.6 Pressure Gauges (Manometers)


7.6.1 Each line to actuate the SESDVs or of the manifold mode of operation shall have a pressure gauge in accordance with I-ET-3010.00-1200-800-P4X-013 - **GENERAL CRITERIA FOR INSTRUMENTATION PROJECTS and FIELD INSTRUMENTATION**. Also, the following additional requirements shall be met:

- Connection: top ½" NPT male;
- Pulse damper: required;
- Glycerin filled: required;
- Back rupture disk: required;
- Double scale in kPa and psi: 0 – 27,600 kPa (0 – 4,000 psi) for the SESDVs valves.

7.7 Filter


7.7.1 One filter shall be foreseen on each of hydraulic fluid supply lines inlet, with the following characteristics, in accordance to ISO 16889:

- Body: AISI 316;
- Filtering element: AISI 316;
- Mesh: 3 µm abs ($\beta \geq 200$);
- Connections: 3/8" NPT socket;
- Differential pressure indicator: required;
- Operation pressure: as in item 3.6.

	TECHNICAL SPECIFICATION	Nº: I-ET-3010.00-1210-888-P4X-003	REV. A
	UNIT:	SHEET 13 of 15	
	TITLE:	INTERNAL	
SESDVS CONTROL RACK		ESUP	

8 IDENTIFICATION


- 8.1 All connections and instruments shall be clearly identified.
- 8.2 The identification plates shall be made of AISI 316L with lettering in low relief fixed by stainless steel screws.
- 8.3 The rack shall be clearly and permanently identified on its front part with a 200 x 75 mm plate with the following inscriptions respectively (to be adapted according to the UNIT number and specific panel TAG):

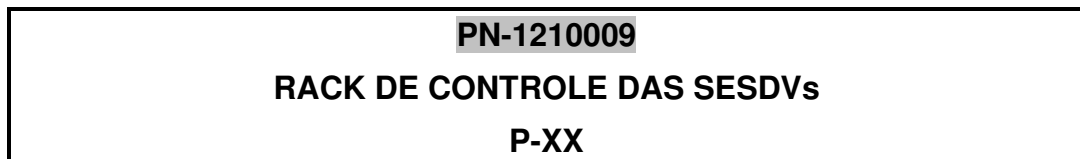

- 8.4 The manifold blocks corresponding to each well shall be equally identified with plates indicating the well number.
- 8.5 All equipment shall clearly be identified by means of a stainless steel engraved plate containing identification (tag name) and description, according to Project's EQUIPMENT LIST and containing identification according to Brazilian standard regulation NR-12 - SEGURANÇA NO TRABALHO EM MÁQUINAS E EQUIPAMENTOS. Internal components shall also be identified. Identification shall be in Brazilian Portuguese. External nameplates shall be adequate for external use.

9 DOCUMENTATION

- 9.1 Complete documentation of the SESDVs Control Rack, covering all devices and services, shall be supplied with the proposal, for approval, and for final acceptance.
- 9.2 There shall be supplied with the proposal, in the number of copies defined at PETROBRAS documents, at least the following technical documents:
- Technical specifications comprising: equipment, accessories, panel and materials;
 - Data-sheets and brochures for each equipment;
 - All equipment and installation data including: material list, equipment list, spare part list, power consumption, weight, panel lay-out, etc;
 - Complete description of services, tests, etc.
- 9.3 There shall be supplied for approval, in the number of copies defined at PETROBRAS documents, at least the following technical documents:
- Technical specifications comprising: equipment, instrument, accessories, cables, tubing and materials;
 - Data-sheets and drawings for the panel and each instrument;

	TECHNICAL SPECIFICATION	Nº: I-ET-3010.00-1210-888-P4X-003	REV. A
	UNIT:	SHEET 14 of 15	
	TITLE:	SESDVS CONTROL RACK	
		INTERNAL	
		ESUP	

- Installation drawings including general arrangement, electrical diagrams, hydraulic diagrams, wiring diagrams, cable/tubing list, material list, equipment list;
- Test procedures;
- Certificate of materials etc.
- Manifold Documentation

9.4 Complete SESDVs Control Rack certified documentation shall be provided in digital media (USB flash drive) and in as many copies as requested by PETROBRAS documents.

10 ACCEPTANCE TESTS

10.1 The following tests shall be performed at MANUFACTURER installations (FAT) prior to delivery:

- Visual inspection;
- Tightness/leakage;
- Functional Test,/ Loop test;
- Electric Isolation;
- Cleanliness class of hydraulic fluid;
- Calibration, configuration and diagnostic of each field instrument.

10.2 After the installation of the equipment on board, at least, the following tests shall be repeated (SAT).

- Visual inspection;
- Tightness/leakage;
- Functional Test;
- Loop test;
- Electric Isolation.

10.3 For Site Integration Tests (SIT) all the tests performed during FAT shall be repeated.


10.4 In order to shorten the time at the tests on board, the documentation shall be checked at platform office.

10.5 There shall also be provided all functional tests regarding operational and safety aspect, as detailed at the Tests Program approved by PETROBRAS.

10.6 All tests shall be according to IEC 62381.

10.7 SIT shall be executed with the SESDVs Control Rack interconnected with the Hydraulic Power Unit.

10.8 It shall be submitted to PETROBRAS, for approval, detailed FAT, SAT and SIT programs 60 (sixty) days in advance.

	TECHNICAL SPECIFICATION	Nº: I-ET-3010.00-1210-888-P4X-003	REV. A
	UNIT:	SHEET 15 of 15	
	TITLE:	SESDVS CONTROL RACK	INTERNAL
			ESUP

11 PACKING REQUIREMENTS

- 11.1 On completion of testing at factory all equipment shall be prepared for shipment and storage.
- 11.2 Equipment supplied loose shall be packed and crated for transport. In addition, if some rack equipment is susceptible to transport damage, shall be removed from de System Rack for separate packing and crating.
- 11.3 The packing shall be designed in order to withstand transportation by sea on a tug deck, being exposed to soaking by waves.