

 <b>PETROBRAS</b>	<b>TECHNICAL SPECIFICATION</b>					I-ET-3010.00-5524-854-PX9-001					
	CLIENT					PETROBRAS				SHEET	1 of 17
	JOB					SESDV MONITORING SYSTEM					
	AREA										
SUB	TITLE					<b>MONITORING SYSTEM FOR SUBSEA EMERGENCY SHUT-DOWN VALVE (SESDV) – FPU SCOPE</b>				<b>INTERNAL</b>	
										SUB/ES/EDA/EAI	
<b>REVISION INDEX</b>											
REV.	DESCRIPTION AND/OR REVISED SHEETS										
0	Original - This document is based on the previous technical specification for Monitoring System for Subsea Emergency Shut Down Valve (SESDV) FPU Scope: <i>I-ET-3000.00-1510-854-PEK-002_D</i>										
	REV. 0	REV. A	REV. B	REV. C	REV. D	REV. E	REV. F	REV. G	Rev H		
DATE	28/02/2025										
DESIGN	EAI										
EXECUTION	BYE8										
CHECK	DVHV										
APPROVAL	NTHF										
THE INFORMATION CONTAINED IN THIS DOCUMENT IS PETROBRAS PROPERTY AND MAY NOT BE USED FOR PURPOSES OTHER THAN THOSE SPECIFICALLY INDICATED HEREIN.											
THIS FORM IS PART OF PETROBRAS N-0381 REV. L											

## TABLE OF CONTENTS

1	INTRODUCTION .....	3
2	ABBREVIATIONS .....	3
3	REFERENCE DOCUMENTS, CODES AND STANDARDS .....	3
3.1	International standards .....	3
3.2	PETROBRAS Documents.....	4
4	DEFINITIONS.....	4
5	TECHNICAL CHARACTERISTICS .....	5
5.1	Design and fabrication .....	5
5.2	Qualification .....	5
6	GENERAL TECHNICAL REQUIREMENTS .....	5
6.1	System overview .....	5
7	MONITORING SYSTEM TOPSIDE COMPONENTS .....	7
7.1	Topside system overview.....	7
7.2	SESDV Topside Processing .....	7
7.3	ICSS Interface.....	8
7.4	Software Requirements .....	8
7.5	SESDV Electrical JBs .....	10
7.6	SESDV topside cabling.....	11
7.7	Umbilical Topside Interface.....	11
8	MONITORING SYSTEM SUBSEA COMPONENTS .....	12
8.1	SUBSEA Instrumentation.....	12
9	INSTALLATION AND COMMISSIONING REQUIREMENTS.....	13
10	TECHNICAL DOCUMENTATION .....	14
11	TESTS AND INSPECTIONS .....	14
12	SESDV MONITORING SYSTEM SCOPES .....	14
12.1	FPU CONTRACTOR/SELLER responsibilities .....	14
12.2	FPU OPERATOR responsibilities .....	15
12.3	UMBILICAL CONTRACTOR responsibilities .....	15
12.4	SESDV CONTRACTOR responsibilities .....	15
12.5	Scopes of Supply .....	16
12.6	Scopes of Work.....	17

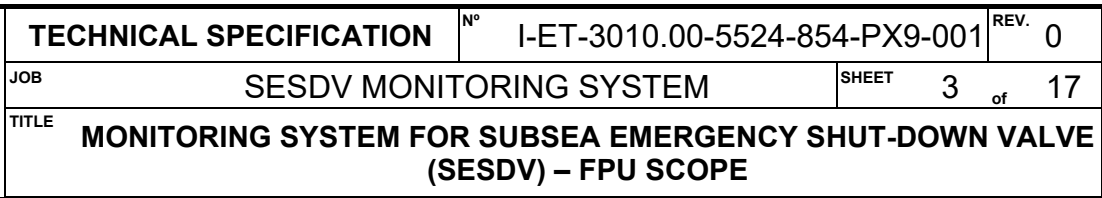

### 3.1 International standards

	<b>TECHNICAL SPECIFICATION</b>		Nº	I-ET-3010.00-5524-854-PX9-001	REV.	0	
	JOB			SESDV MONITORING SYSTEM		SHEET	4 of 17
	TITLE						
<b>MONITORING SYSTEM FOR SUBSEA EMERGENCY SHUT-DOWN VALVE (SESDV) – FPU SCOPE</b>							

[1]API 6A - Specification for Wellhead and Christmas Tree Equipment

[2]API 17E – Specification for Subsea Umbilicals

[3]API 17F - Standard for Subsea Production Control Systems

[4]API 17Q - Recommended Practice on Subsea Equipment Qualification

[5]ASME B16.5:2013 - Standard Specification for Alloy-Steel and Stainless Steel Bolting for Low-Temperature Service

[6]ASME B16.5:2013 - Pipe Flanges and Flanged Fittings

[7]DNVGL-RP-B401:2017 - Cathodic Protection Design

[8]IEC 60079 (latest revision) - Series Explosive Atmosphere Standards

[9]IEC 60092 (latest revision) - Electrical installations in ships - ALL PARTS

[10] IEC 60502-1- Power cables with extruded insulation and their accessories for rated voltages from 1 kV (Um = 1,2 kV) up to 30 kV (Um = 36 kV)

[11] IEC 60529 (latest revision) - Degrees of Protection Provided by Enclosures (IP Code)

[12] IEC 61892-6 (latest revision) - Mobile and fixed offshore units – Electrical installations – Part 6: Installation

[13] DNV-RP-H103 - Modelling and Analysis of Marine Operations

[14] ISO 13628-6:2006 - (**Note:** The cleaning classification for hydraulic fluids of the old NAS 1638 standard ("Cleanliness Requirements used in Hydraulic Systems") is cited in this specification as a reference best known by the industry. The most current standard is SAE AS 4059 ("Cleanliness Classification for Hydraulic Fluids"));

### 3.2 PETROBRAS Documents

[15] I-ET-3000.00-1510-800-PEK-002 UMBILICAL TERMINATION ASSEMBLY (UTA) CONTROL SYSTEM – FOR SUBMARINE EXPORT SYSTEMS


[16] I-ET-3010.2Q-1200-850-P4X-001- SPECIAL MONITORING SYSTEMS (*if applicable*)

[17] I-ET-3000.00-1519-29B-PZ9-012- TOPSIDE ARRANGEMENT AND INTERFACES WITH SUBSEA UMBILICAL SYSTEMS

### 4 DEFINITIONS

SESDV CONTRACTOR	The company responsible to design, construct and supply the SESDV SYSTEM
FPU CONTRACTOR/SELLER	The entity that is responsible for the Engineering, Procurement, and Construction of the Floating Production Unit (FPU), as established in the contract of the FPU and supply the FPU topside infrastructure of SESDV SYSTEM
FPU OPERATOR	PETROBRAS or company contracted by PETROBRAS to operate FPU topside.

	<b>TECHNICAL SPECIFICATION</b>		Nº I-ET-3010.00-5524-854-PX9-001	REV. 0
	JOB		SESDV MONITORING SYSTEM	
	TITLE		MONITORING SYSTEM FOR SUBSEA EMERGENCY SHUT-DOWN VALVE (SESDV) – FPU SCOPE	
SHEET		5 of 17		

SUPPLIER	Company hired by FPU CONTRACTOR/SELLER, to supply components from SESDV MONITORING SYSTEM.
MAY	It is used when alternatives are equally acceptable
SHOULD	It is used when a provision is not mandatory, but is recommended as a good practice
SHALL	It is used when a provision is mandatory
AVAILABILITY	Probability that the system will remain operating under the conditions specified in the project during its useful life.

## 5 TECHNICAL CHARACTERISTICS

### 5.1 Design and fabrication

5.1.1 All subsea monitoring components shall be designed in accordance with [2] and [3].

5.1.2 Selection of materials for all subsea structures shall be in accordance with [7] item 5.5 and be designed for the same design life as the SESDV.

5.1.3 All enclosures and equipment to be placed in hazardous areas shall comply and be certificated according to [8].

5.1.4 All enclosures with a required degree of ingress protection shall comply with [11].

5.1.5 All electrical cabling specifications and installations shall comply with [9] and IEC [12].

5.1.6 Electrical and communication analyses shall be performed, including simulations considering the parameters of specified cable types (for deck and umbilical lines). For electrical analysis, the maximum length of the UEH shall be 10 km using TSP conductors with 2.5mm<sup>2</sup> cross section.

### 5.2 Qualification

5.2.1 All subsea equipment shall be qualified in accordance with [3], [4] or [14].


## 6 GENERAL TECHNICAL REQUIREMENTS

### 6.1 System overview

6.1.1 Each SESDV foreseen at field project shall receive electrical conductors, coming from the FPU, through a general arrangement using UEH and UTA, as shown in Figure 1.

6.1.2 The monitoring system and actuation can follow two arrangement options:

- One umbilical connects FPU to just one SESDV (Option 1 –Figure 1).
- One umbilical connects FPU to more than one SESDV, through a SDU (Option 2 -Figure 1).

	TECHNICAL SPECIFICATION	Nº I-ET-3010.00-5524-854-PX9-001	REV. 0
	JOB	SESDV MONITORING SYSTEM	SHEET 6 of 17
	TITLE	MONITORING SYSTEM FOR SUBSEA EMERGENCY SHUT-DOWN VALVE (SESDV) – FPU SCOPE	

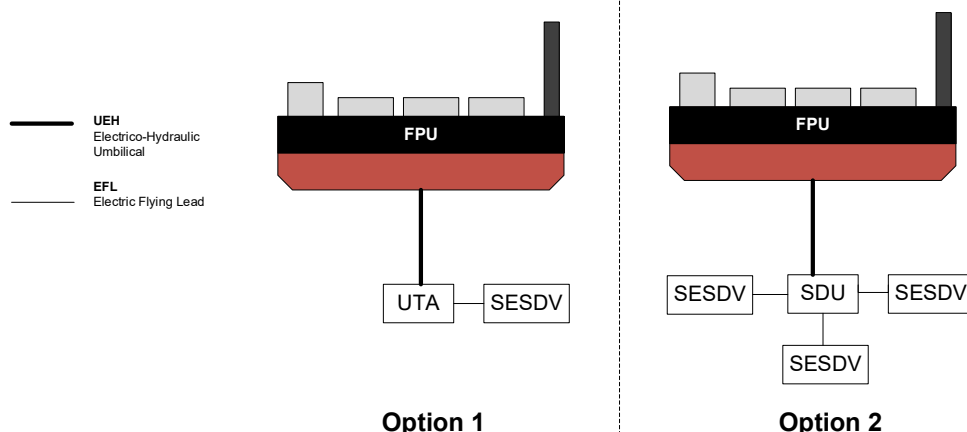


Figure 1: General schematic of the subsea layout with SESDV Monitoring System.

**6.1.3** This technical specification describes FPU provisions for SESDV monitoring system. FPU CONTRACTOR/SELLER shall provide the required structure for all SESDV foreseen in field project. The base case for this technical specification is Option 1, however if the subsea layout would foresee Option 2, the topside supply (i.e., topside cabling and acquisition channels) shall be dimensioned accordingly.

**6.1.4** Figure 2 presents the general architecture of SESDV Monitoring System

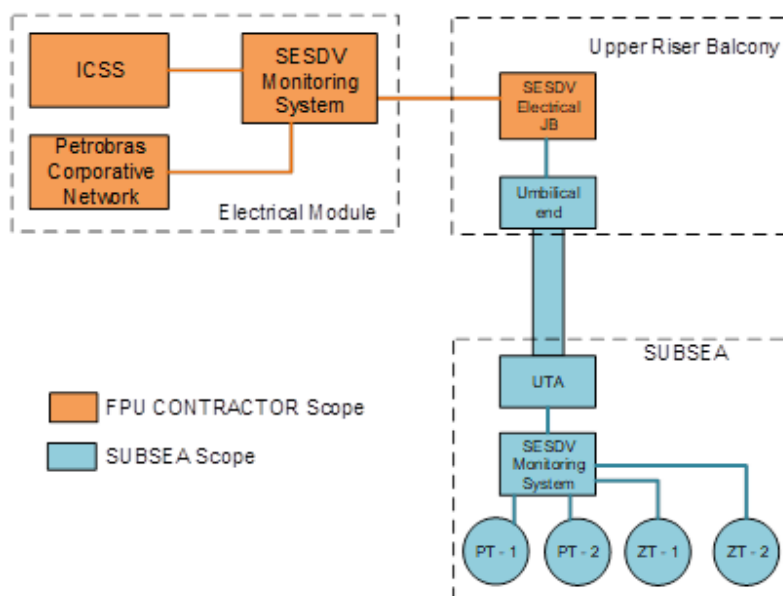


Figure 2: General Architecture of SESDV Monitoring System.


**6.1.5** Cabling shall be designed in accordance with international standards.

**6.1.6** Connectors/terminations shall be properly protected from exposure before final assembly to junction boxes and other equipment.

**6.1.7** All junction boxes/cabinets shall be properly identified with visible tags.

**6.1.8** All cabling (at dry area) shall be properly identified with visible tags.



 <b>PETROBRAS</b>	<b>TECHNICAL SPECIFICATION</b>		Nº	I-ET-3010.00-5524-854-PX9-001	REV.	0
	JOB	SESDV MONITORING SYSTEM			SHEET	8 of 17
	TITLE	<b>MONITORING SYSTEM FOR SUBSEA EMERGENCY SHUT-DOWN VALVE (SESDV) – FPU SCOPE</b>				

protectors connected to FPU grounding system.

**7.2.5** The SESDV Topside processing shall be powered by a nominal voltage of 220 V AC (+/- 10%), 50-60Hz, to be supplied through a cable including a protective earth conductor.

**7.2.6** SESDV Topside processing shall provide DC power supplies and media converters inside cabinet and prioritize installation using 19-inch multi-slot rack. LAN Network connection (Cat-6 network cable) shall permit remote access by corporative network.

**7.2.7** SESDV Topside processing shall have two communication interfaces:

7.2.7.1 On interface connected to Corporative Network (through Petrobras Firewall) to allow remote access,

7.2.7.2 One interface connected to ICSS to forward sensor data.

**7.2.8** FPU CONTRACTOR/SELLER shall provide user interface devices, including keyboard, mouse, and monitor (KVM - 1U rack mounted), for local access to the supervisory system. All user interface devices shall be installed at a comfortable height for human users and with proper consideration for ergonomics.

**7.3 ICSS Interface**

**7.3.1** The forwarding of sensor data to ICSS can use TCP/IP protocol (observed cybersecurity, considering automation network) and final solution shall be presented for PETROBRAS approval.

**7.3.2** For each SESDV, FPU CONTRACTOR/SELLER shall provide two dry contacts from FPU ICSS for each hydraulic function line. The two dry contacts functions for each line shall be SESDVX\_OPEN\_COMMAND and SESDVX\_CLOSE\_COMMAND (Where “X” is a sequential number). The FPU ICSS logic shall be closing the dry contact for 60 seconds after the command is executed at the solenoid from SESDV HPU rack

**7.3.3** FPU CONTRACTOR/SELLER shall provide cabling needed for required interface between ICSS and SESDV Topside processing.

**7.3.4** FPU CONTRACTOR/SELLER shall terminate at SAK terminals the dry contacts from FPU ICSS and SESDV electrical conductors from SESDV Electrical JB's.

**7.3.5** FPU CONTRACTOR/SELLER shall also record at FPU ICSS the SESDV position indicator (ZT) and pressure indicator (PT) signals.

**7.3.6** The Supervisory screen from the ICSS shall indicate the information of each SESDV sensor from monitoring system.

**7.3.7** Information from SESDV position indicator (ZT) shall be included in the FPU cause and effect matrix.


**7.4 Software Requirements**

**7.4.1** The software shall be based on Microsoft Windows solution. The use of a well-established integrated automation solution able to provide all required functionalities is strongly advised.

**7.4.2** In the case of power loss, the main processing equipment shall be able to restart automatically without the need for operator intervention.

**7.4.3** FPU CONTRACTOR/SELLER shall provide a document, during the commissioning,



	TECHNICAL SPECIFICATION	Nº I-ET-3010.00-5524-854-PX9-001	REV. 0
	JOB	SESDV MONITORING SYSTEM	SHEET 9 of 17
	TITLE	MONITORING SYSTEM FOR SUBSEA EMERGENCY SHUT-DOWN VALVE (SESDV) – FPU SCOPE	

containing all administrator passwords needed to operate and manage all equipment.

- 7.4.4** The software shall act as an interface to human operators and external systems of the monitoring system.
- 7.4.5** Dedicated supervisory screens shall report the value of every monitored variable as they are acquired, along with the status of communication channels of each monitoring unit, including cabinet housekeeping data.
- 7.4.6** The software shall allow for querying and plotting of historical data for user-selectable intervals.
- 7.4.7** Data shall be recorded in sets of array files compatible with Microsoft Excel 2003 or newer (\*.CSV).
- 7.4.8** Data shall have included inside GMT timestamp.
- 7.4.9** A database system for storage of generated all data points (monitored variables and housekeeping) shall be included in a OPC server.
- 7.4.10** The database shall operate on a circular buffer pattern, whereby older records shall gradually be overwritten by newer samples once the database reaches its capacity. Storage space shall be provided as a dedicated RAID 1 array, sized for at least 24 months of logging at the highest possible data sampling rate.
- 7.4.11** The software shall record the SESDV position indicator with sample rate of 1Hz.
- 7.4.12** The software solution shall design a continuous high frequency sample rate (4Hz) circular buffer pattern solution of the acquisition of the pressure transmitter, whereby older records shall gradually be overwritten by newer samples once the buffer reaches its capacity. The buffer window shall be 10 minutes.
- 7.4.13** When the software receives a SESDV OPEN/CLOSE command (dry contacts), the software will extract a 10-minute data array starting 1 minute earlier than the received command as illustrated in Figure 3.

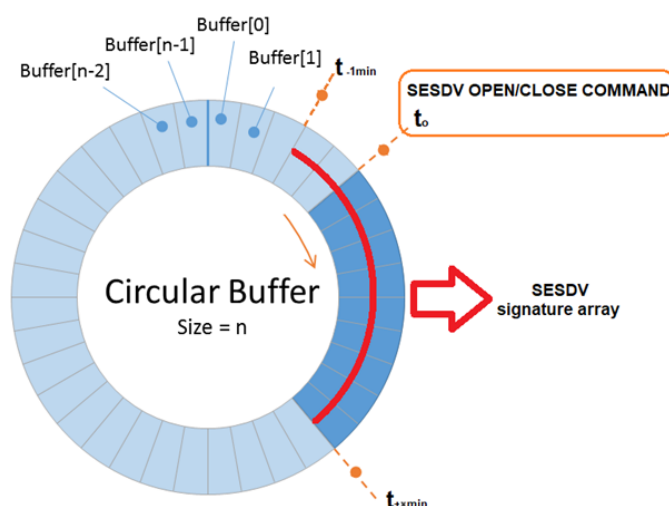



Figure 3: SESDV signature array circular buffer schematic.

- 7.4.14** To comply with the sample frequency requirement on 7.4.12, the PLC shall be able to retrieve the data at high frequencies without any package losses. A buffer solution may be proposed by FPU CONTRACTOR/SELLER. Proposed solution shall be presented to PETROBRAS for review and approval during FPU detailing phase.

	TECHNICAL SPECIFICATION	Nº I-ET-3010.00-5524-854-PX9-001	REV. 0
	JOB	SESDV MONITORING SYSTEM	SHEET 10 of 17
	TITLE	MONITORING SYSTEM FOR SUBSEA EMERGENCY SHUT-DOWN VALVE (SESDV) – FPU SCOPE	

**7.4.15** The data batch shall be compiled into a CSV file and stored. The data shall be available for consultation through Petrobras Corporative Network.

**7.4.16** Confirmation of this functionality shall be done by applying a 2Hz sinusoidal signal (based on Nyquist Rate) at the JB and confirmation that the CSV file is generated with the expected high frequency data upon an open/close command of the valve. This test shall be done during FAT activities at the shipyard. General concept of the test is illustrated on Figure 4.

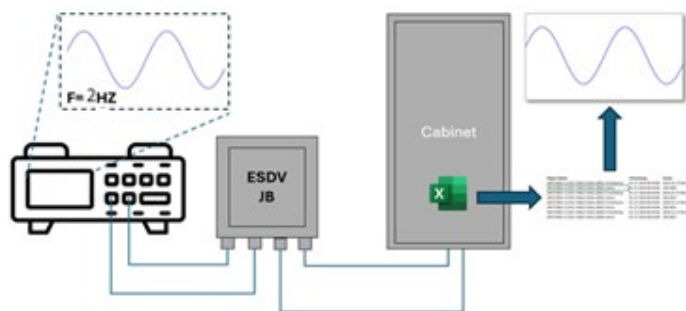


Figure 4: Sine Test general concept.

**7.4.17** Two categories of password protected user accounts shall be implemented, common and privileged. Access to all functionalities of the software shall be restricted exclusively to authenticated users belonging to one of these categories.

**7.4.18** Configuration duties, including the management of the various monitoring units and of the user accounts themselves, shall be restricted to privileged users. All view-only functionalities shall be available to all authenticated users.

**7.4.19** The software shall keep a log of all accesses, both local and remote, for a minimum of 12 months.

**7.4.20** The software shall provide Web Interface (HTTP) access to all screens from within PETROBRAS corporate network. Authenticated users shall be given access to all functionalities just as they are available locally.

**7.4.21** The Web Interface shall be fully compatible with the latest versions of the Internet Explorer, Mozilla Firefox and Google Chrome browsers, without the aid of any plugins.

**7.4.22** At least 20 concurrent accesses to the software shall be supported by the Web Interface.


**7.4.23** The standard Microsoft Windows remote desktop solution shall also be provided to allow remote access to the system from onshore facilities.

## 7.5 SESDV Electrical JBs

**7.5.1** FPU CONTRACTOR/SELLER shall provide one JB (named SESDV Electrical JB) for each SESDV slots position in FPU.

**7.5.2** SESDV Electrical JB shall be installed close to umbilical end of each SESDV.

**7.5.3** SESDV Electrical JB has the function to arrange SESDV electrical signals of 2 (two) PT sensors (main and redundant), and 2 (two) ZT sensors (main and redundant) of each SESDV.

	<b>TECHNICAL SPECIFICATION</b>		Nº	I-ET-3010.00-5524-854-PX9-001	REV.	0
	JOB	SESDV MONITORING SYSTEM			SHEET	11 of 17
	TITLE	<b>MONITORING SYSTEM FOR SUBSEA EMERGENCY SHUT-DOWN VALVE (SESDV) – FPU SCOPE</b>				

7.5.3.1 The PT and ZT sensors shall have its entire electrical interface established by 2 (two) wires, which simultaneously perform the electrical supply and the analog communication (passive 4-20mA sensor). Analog communication and power supply shall be in accordance with Appendix D of [3].

7.5.4 At SESDV Electrical JB, FPU CONTRACTOR/SELLER shall consider 4 inlets for SUBSEA side for each SESDV attended. For these inlets plugs (installed) and cable glands (as spare) shall be provided. After umbilical installation the plugs will be replaced by cable glands.

7.5.5 FPU CONTRACTOR/SELLER shall consider that one umbilical can attend more than one SESDV (See Figure 1).

7.5.6 The connection of four sensors shall demand three (positive sharing) or four (one pair to each sensor) pairs depending on subsea electrical connection. See Figure 5.

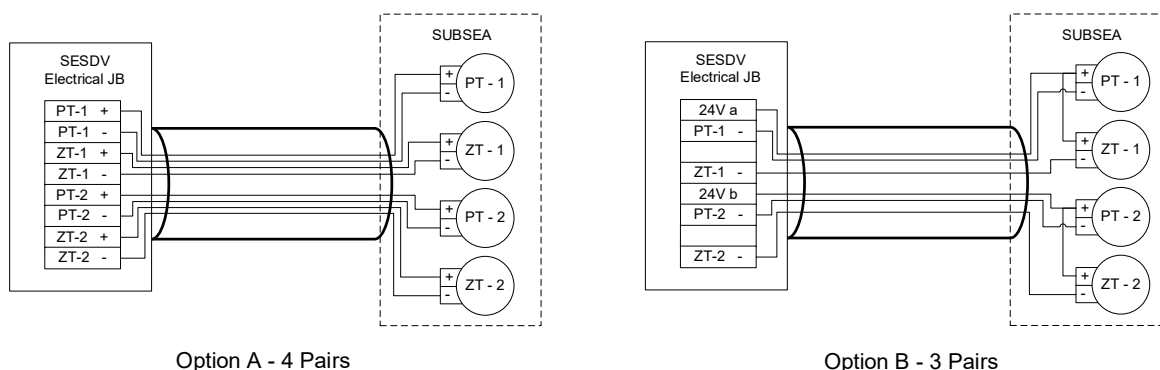


Figure 5: SESDV Monitoring System electrical wiring.

7.5.7 FPU CONTRACTOR/SELLER shall provide infrastructure able to support both scenarios of Figure 5.

7.5.8 To arrange SESDV signals, these JB's shall aggregate electrical conductors at SAK terminals according to the UEH configuration (3 pairs or 4 pairs).

7.5.9 Each SESDV Electrical JB shall be installed in places with easy access, in maximum height of 2 meters and where is dismissed the use of safety harness for high work.

7.5.10 Each SESDV Electrical JB shall be sealed against dust and powerful water jets (protection degree IP-66).

7.5.11 Each SESDV Electrical JB and cable glands specification/installation shall be in accordance with its corresponding area classification.

## 7.6 SESDV topside cabling


7.6.1 FPU CONTRACTOR/SELLER shall provide cabling for each SESDV functions slots position in FPU.

7.6.2 FPU CONTRACTOR/SELLER shall provide two multicable (main and spare) with 4 TSP with conductor cross section of 4mm<sup>2</sup> for each SESDV foreseen in project. These multicables shall connect the cabinet and the respective SESDV Electrical JB.

## 7.7 Umbilical Topside Interface

7.7.1 FPU CONTRACTOR/SELLER shall provide electrical and hydraulic umbilical interface in accordance with [18].

7.7.2 It is FPU CONTRACTOR/SELLER responsibility to provide hydraulic tubes and hoses

	TECHNICAL SPECIFICATION	Nº I-ET-3010.00-5524-854-PX9-001	REV. 0
	JOB	SESDV MONITORING SYSTEM	SHEET 12 of 17
	TITLE	MONITORING SYSTEM FOR SUBSEA EMERGENCY SHUT-DOWN VALVE (SESDV) – FPU SCOPE	

for connecting the umbilical hydraulic pigtails to the corresponding TUTU plate connection points.

**7.7.3** It is FPU CONTRACTOR/SELLER responsibility to provide all cable glands and electrical terminations to be used for the installation of the umbilical electrical pigtail to the internal block terminals inside the electrical JB.

## 8 MONITORING SYSTEM SUBSEA COMPONENTS

### 8.1 SUBSEA Instrumentation

**8.1.1** This section describes the subsea components, to provide FPU CONTRACTOR/SELLER with subsea system topology.

**8.1.2** The electrical system shall have in its composition the submarine instrumentation comprising of:

8.1.2.1 2 (two) PT sensors (main and redundant), resident inside the MONITORING MODULE (ROV retrievable module), with the function of monitor the pressure of the actuation hydraulic line of the SESDV.

8.1.2.2 2 (two) ZT sensors (main and redundant), resident inside the SESDV actuation structure, with the function of monitor the position indication of the SESDV shutter.

**8.1.3** The PT and ZT sensors shall have their entire electrical interface established by 2 (two) wires, which simultaneously perform the electrical supply and the analog communication (passive 4-20mA sensor). Analog communication and power supply shall be in accordance with Appendix D of [3].


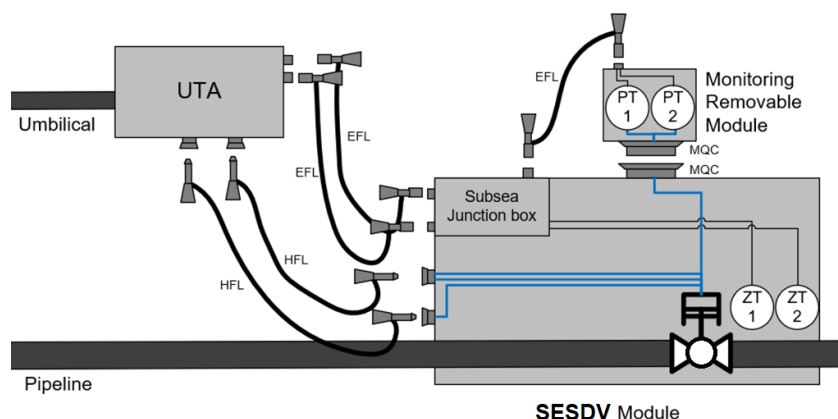



Figure 6: SESDV MONITORING SYSTEM subsea general schematic

**8.1.4** Features of PT sensors:

- Calibration range: 0 to 7500 psi
- Maximum allowable pressure: 10k psi
- Break pressure: 15k psi
- Stability:  $\pm 0.1$  % FS/year
- Accuracy:  $\pm 0.2$  % FS ("zero / span setting and temperature effects" - TOTAL ERROR BAND)

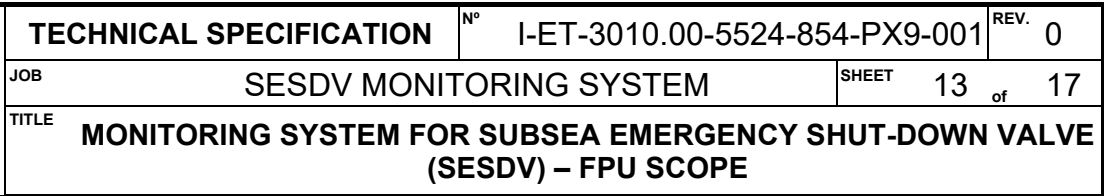

- 9.1.1** The requirements presented in this section shall be met regarding commissioning activities. Planning of installation and commissioning activities shall be developed and submitted for PETROBRAS approval.
- 9.1.2** Commissioning is understood, in this context, as the process of placing the system (or parts thereof related to a particular monitored structure) in a fully functional state, without any pending issues.
- 9.1.3** All equipment shall be tested onshore before deployment at sea. Testing and interventions on equipment shall not be planned or performed during offshore deployment (on deck), save for emergency occasions, in which case approval shall be explicitly given by PETROBRAS.
- 9.1.4** The fully commissioning of SESDV Monitoring system is in SESDV CONTRACTOR scope, however, FPU CONTRACTOR/SELLER, shall commission all topside infrastructure in its scope.
- 9.1.5** In terms of Acceptance Test, the FPU CONTRACTOR/SELLER shall evidence, at least:
- Cabling and power supply
  - Certification of all network cables related to SESDV Monitoring System
  - Fully testing of each SESDV cabling
  - FPU ICSS dry contacts tests
  - Fully testing of each SESDV topside software functions using simulators
  - Data batch test as described at 7.4.16
- 9.1.6** FPU CONTRACTOR/SELLER shall provide all infrastructure for SESDV CONTRACTOR, to allow it to complete the fully commissioning of SESDV Monitoring system (offshore), including access to installation, power supply and information related the system.

	TECHNICAL SPECIFICATION	Nº	I-ET-3010.00-5524-854-PX9-001	REV.	0
	JOB	SESDV MONITORING SYSTEM		SHEET	14 of 17
	TITLE	MONITORING SYSTEM FOR SUBSEA EMERGENCY SHUT-DOWN VALVE (SESDV) – FPU SCOPE			

## 10 TECHNICAL DOCUMENTATION

**10.1.1** During de executive design shall be issued to PETROBRAS approval a Technical Proposal of the FPU CONTRACTOR/SELLER scope, including Datasheets, manuals and certificates for all equipment or cable supplied by FPU CONTRACTOR/SELLER

**10.1.2** The FPU CONTRACTOR/SELLER technical documentation shall include at least the following:

- One Line diagram
- Piping and Instrumentation Diagram (P&ID)
- Interconnection Diagram
- General arrangement of cabinet installation
- General arrangement of all topside installation, including cable routing, mechanical details and equipment datasheet
- Typical detail of installation at each SESDV slot showing at least junction box, conduits, cable tray (if applicable) connector, and fixation
- Factory Acceptance Test Procedure/Reports
- Acceptance and Performance test (TAP) Procedure/Reports

## 11 TESTS AND INSPECTIONS

**11.1.1** With respect to Topside FATs:

**11.1.1.1** The list of FATs of MONITORING SYSTEM, in addition to the FAT procedures themselves, shall be submitted for approval by PETROBRAS during the project detailing phase.

**11.1.2** The factory tests program shall demonstrate that all components of MONITORING SYSTEM have been successfully installed and connected and that MONITORING SYSTEM is fully operational including external services (using simulators).

## 12 SESDV MONITORING SYSTEM SCOPES

### 12.1 FPU CONTRACTOR/SELLER responsibilities

**12.1.1** Supply, install and interconnect corresponding cabinet for SESDV Monitoring system.

**12.1.2** Provide transmission of dry contacts control from FPU ICSS data.

**12.1.3** Provide a network connection to the SESDV Monitoring system.

**12.1.4** Provide assistance to all activities to be performed by the SESDV CONTRACTOR aboard the FPU, including any crane operation, transportation of loads, heavy mechanical installations and issuance of work permits when needed.

**12.1.5** Supply and run all deck and FPU ICSS cabling, including terminations.

**12.1.6** Design, supply and install SESDV Electrical JBs & accessories, providing connections between deck cables and corresponding cabinet.

**12.1.7** Provide documentation with all information needed for the design of the monitoring system, including but not limited to cabling information, wiring diagrams, area classification, mechanical, electrical interfaces and diving accessibility report.

**12.2 FPU OPERATOR responsibilities**

**12.2.1** Install umbilical hang off and support umbilical pull in operations.

**12.2.2** Install umbilical electrical pigtails with cable glandes in SESDV Electrical JBs.

**12.3 UMBILICAL CONTRACTOR responsibilities**


**12.3.1** Design, supply and install UTA and umbilical line.

**12.4 SESDV CONTRACTOR responsibilities**


**12.4.1** Design, supply, install and interconnect SUBSEA equipment for SESDV Monitoring system.

**12.4.2** Execute the fully commissioning of SESDV Monitoring system (offshore).


**12.4.3** Provide information about calibration curves from the sensors to be updated on the supervisory system.

	TECHNICAL SPECIFICATION	Nº I-ET-3010.00-5524-854-PX9-001	REV. 0
	JOB	SESDV MONITORING SYSTEM	SHEET 16 of 17
	TITLE	MONITORING SYSTEM FOR SUBSEA EMERGENCY SHUT-DOWN VALVE (SESDV) – FPU SCOPE	

12.5 Scopes of Supply

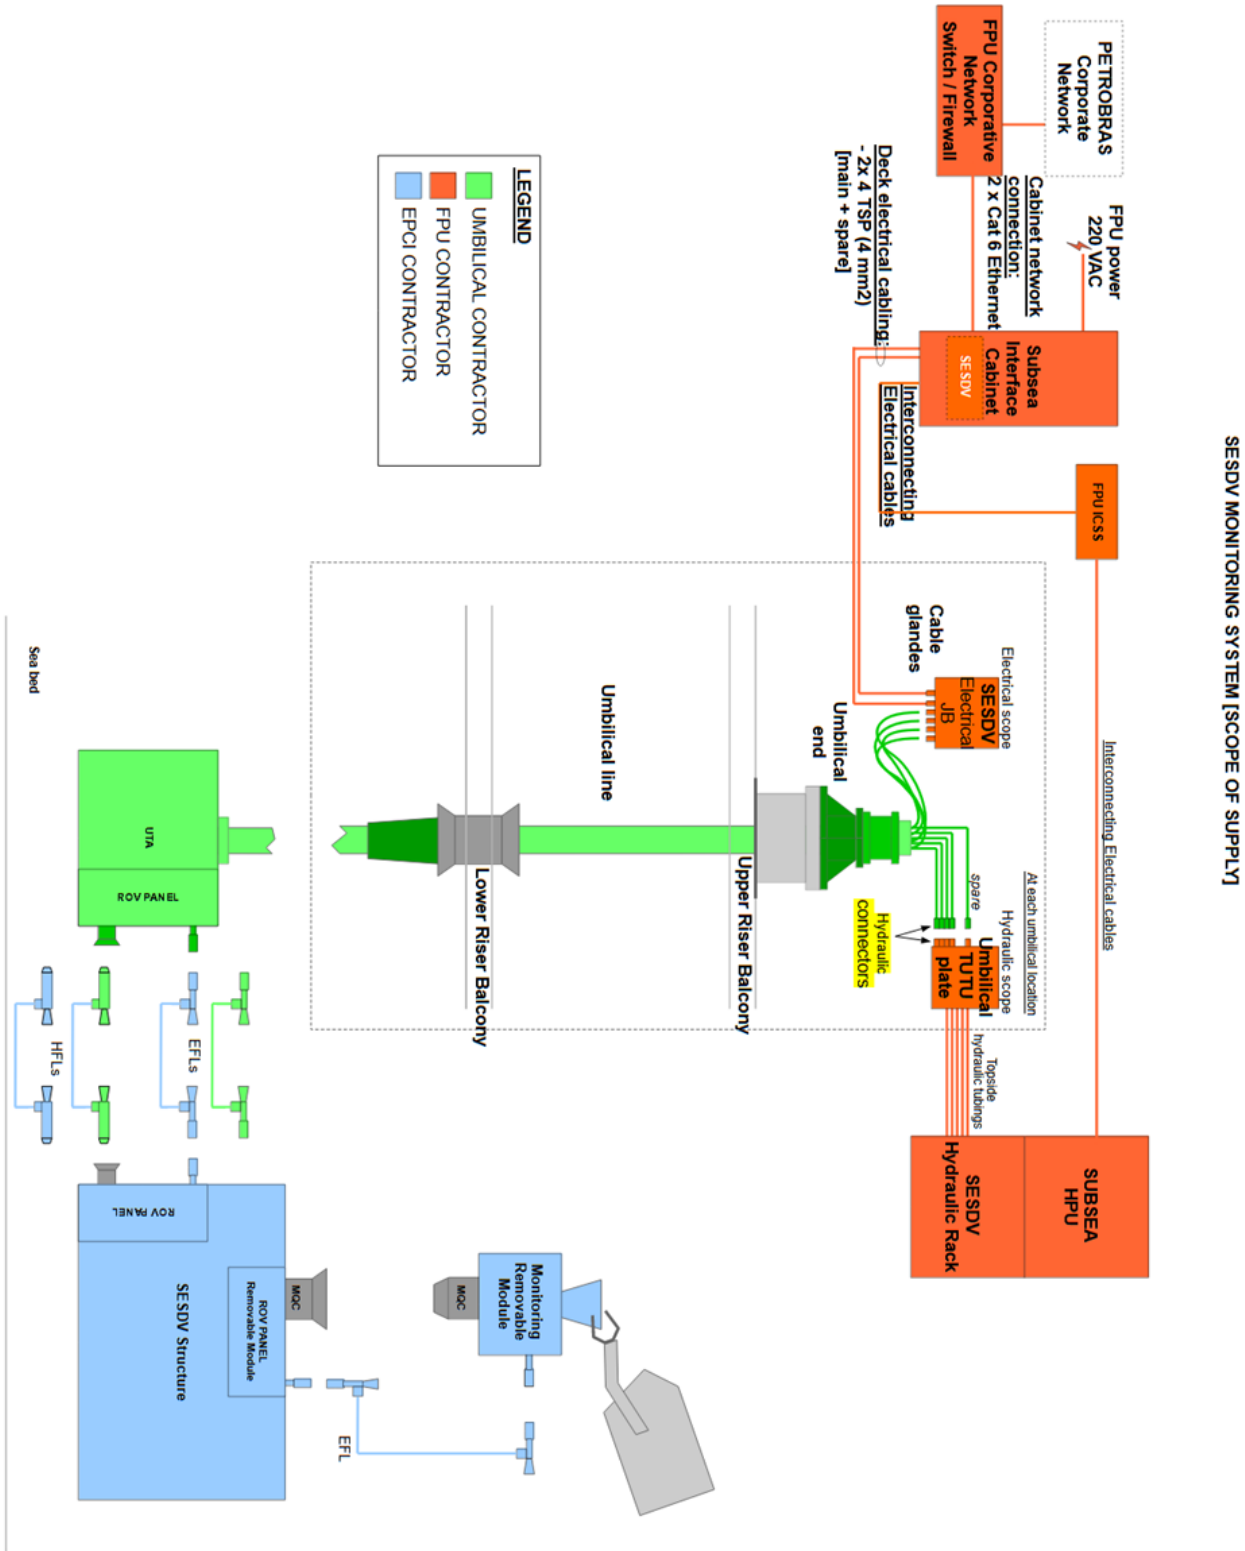



	TECHNICAL SPECIFICATION	Nº I-ET-3010.00-5524-854-PX9-001	REV. 0
	JOB	SESDV MONITORING SYSTEM	SHEET 17 of 17
	TITLE	MONITORING SYSTEM FOR SUBSEA EMERGENCY SHUT-DOWN VALVE (SESDV) – FPU SCOPE	

12.6 Scopes of Work

